

Report No.:AX-DL-AD-15W-075

Test Time: 2025-09-13 15:28

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: 50D

Luminous Length (mm): -68

Voltage: 227.9 V

Power: 14.90 W

Luminous Width (mm): -68

Current: 0.106 A

Power Factor: 0.612

Photometric Results

CIE Class: Direct

Measurement Flux: 1469 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H50.5

Vertical Diffuse Angle(50%): V50.5

Luminaire Efficacy Rating (LER): 98.64

Max. Intensity: 2179.25 cd

S/MH(C0/C180): 0.84

Total Rated Lamp Lumens: 1469.0 lm

Efficiency: 100%

Upward Ratio: 0%

Central Intensity: 2133.94 cd


Pos of Max. Intensity: H180 V8

S/MH(C90/C270): 0.84

Picture Of Luminaire



Luminous Intensity Distribution Curve

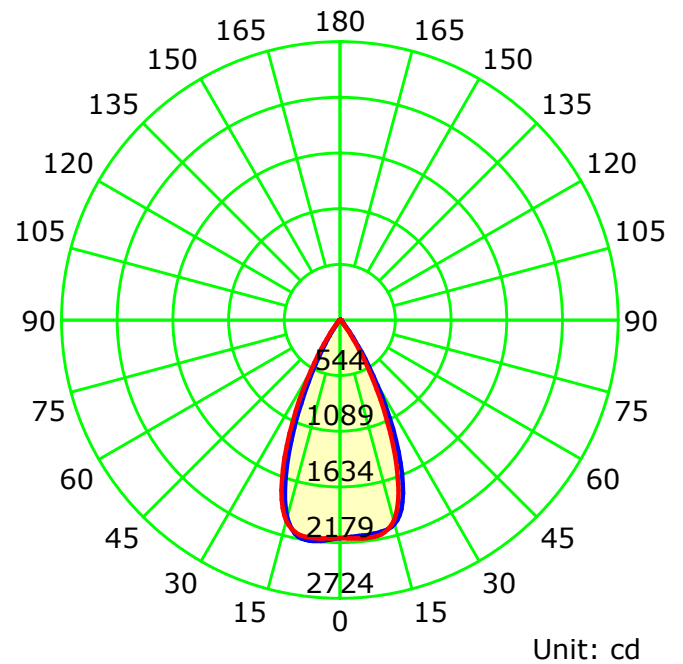

— C0-C180 — C90-C270

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0



Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

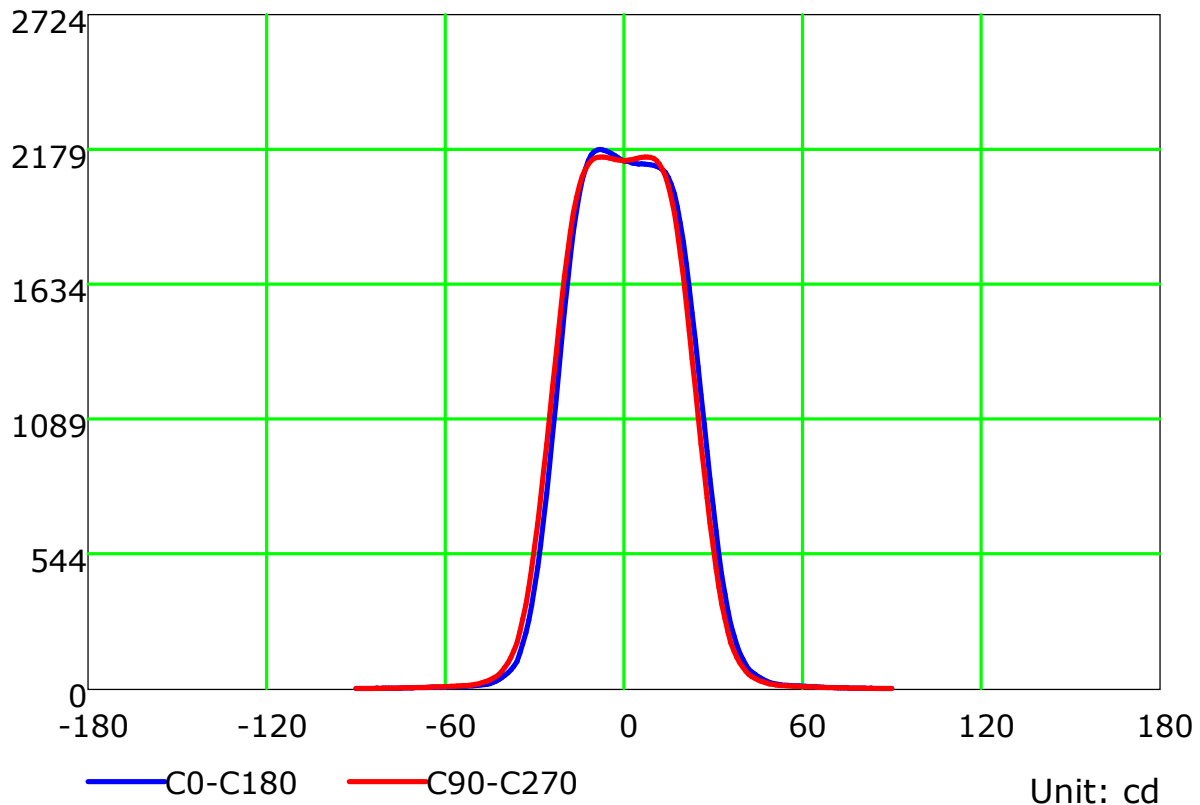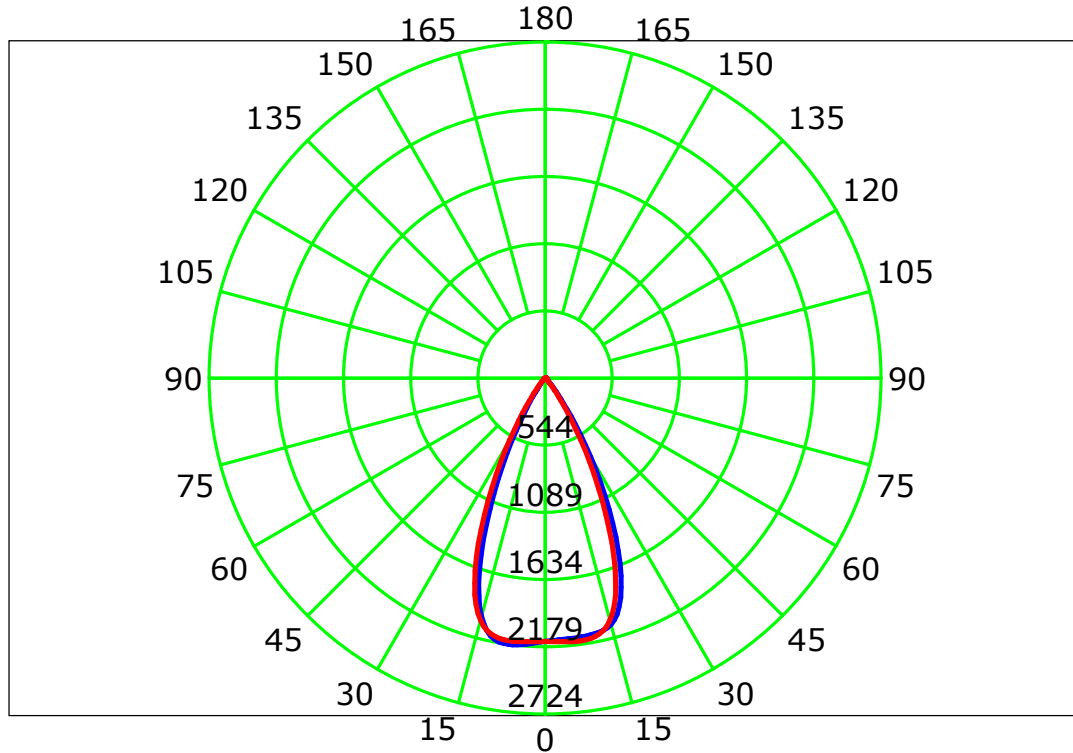

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

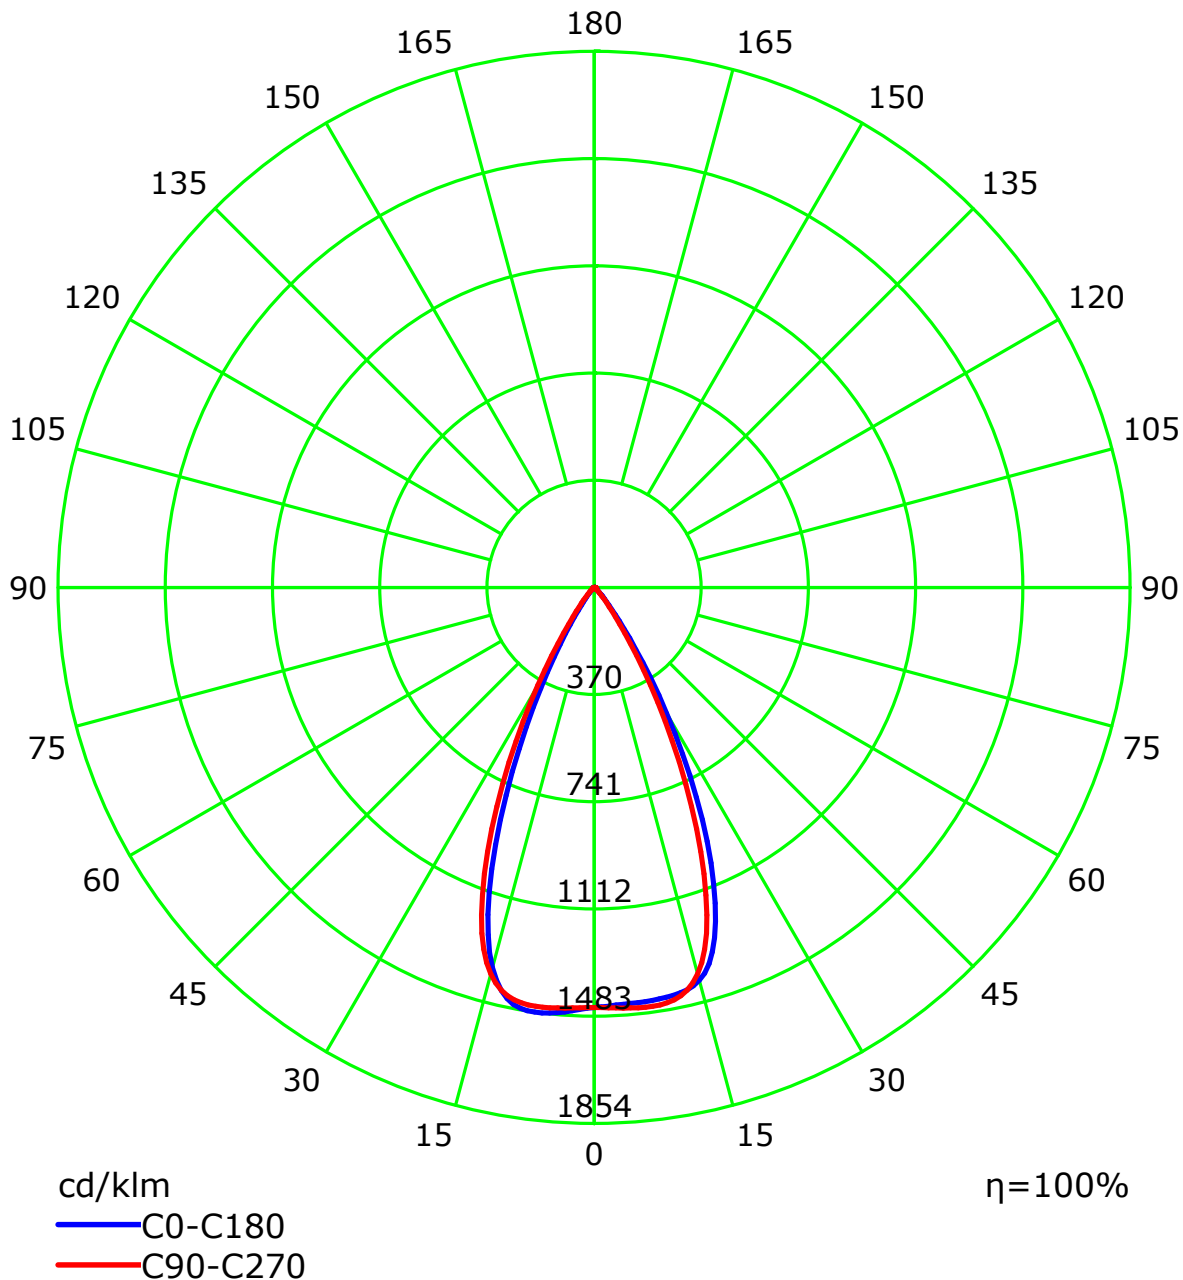

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Isocandela (rectangle)

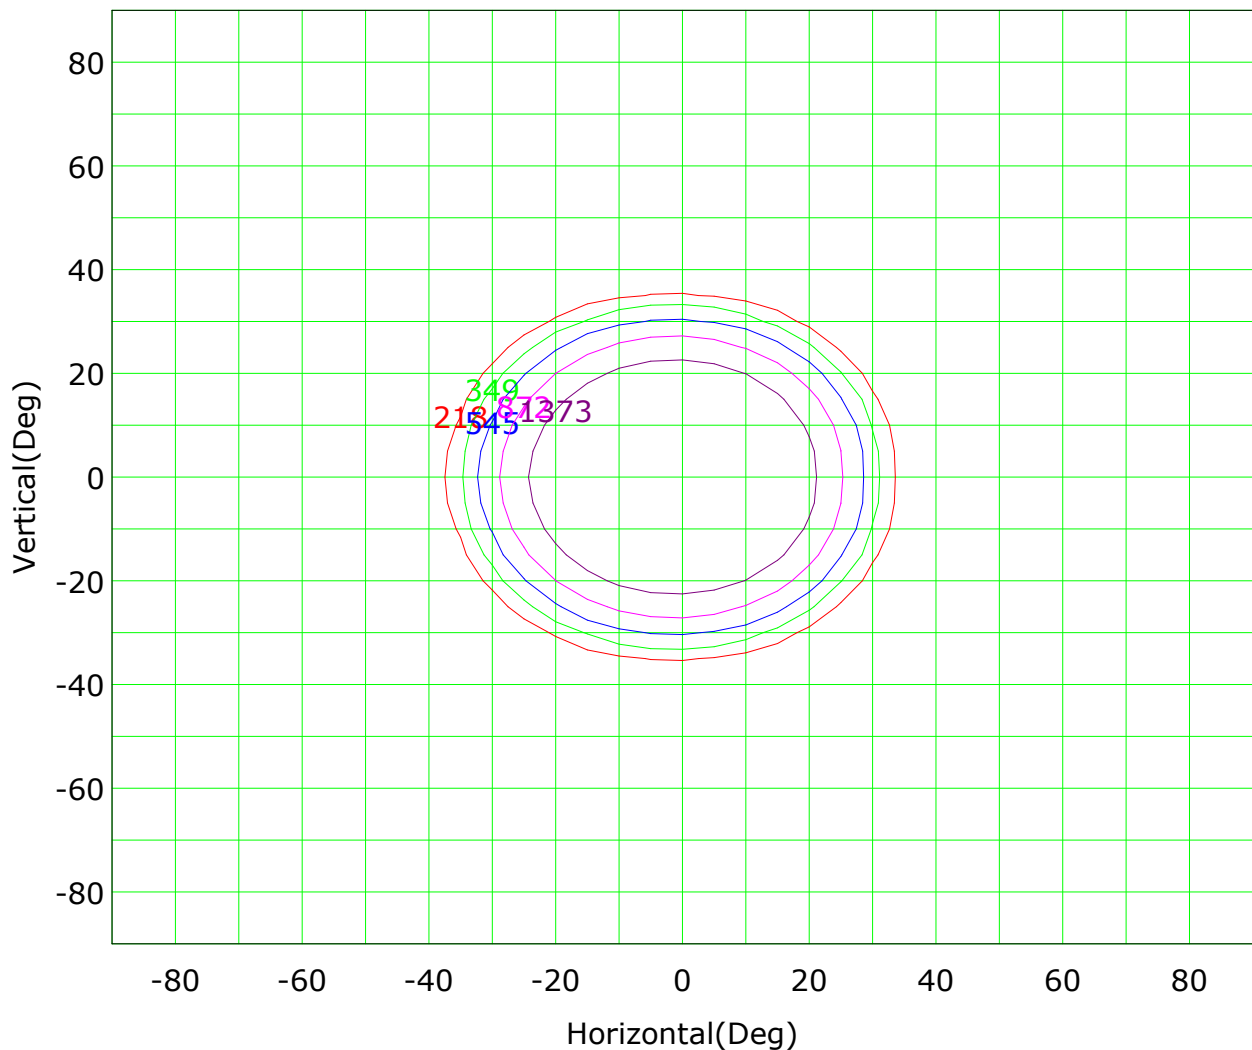

Imax (100%): 2179 cd

| | |
|-----------------|-----------------|
| (10%): 218 cd | (16%): 349 cd |
| (25%): 545 cd | (40%): 872 cd |
| (63%): 1373 cd | (100%): 2179 cd |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

IsoLux Plot

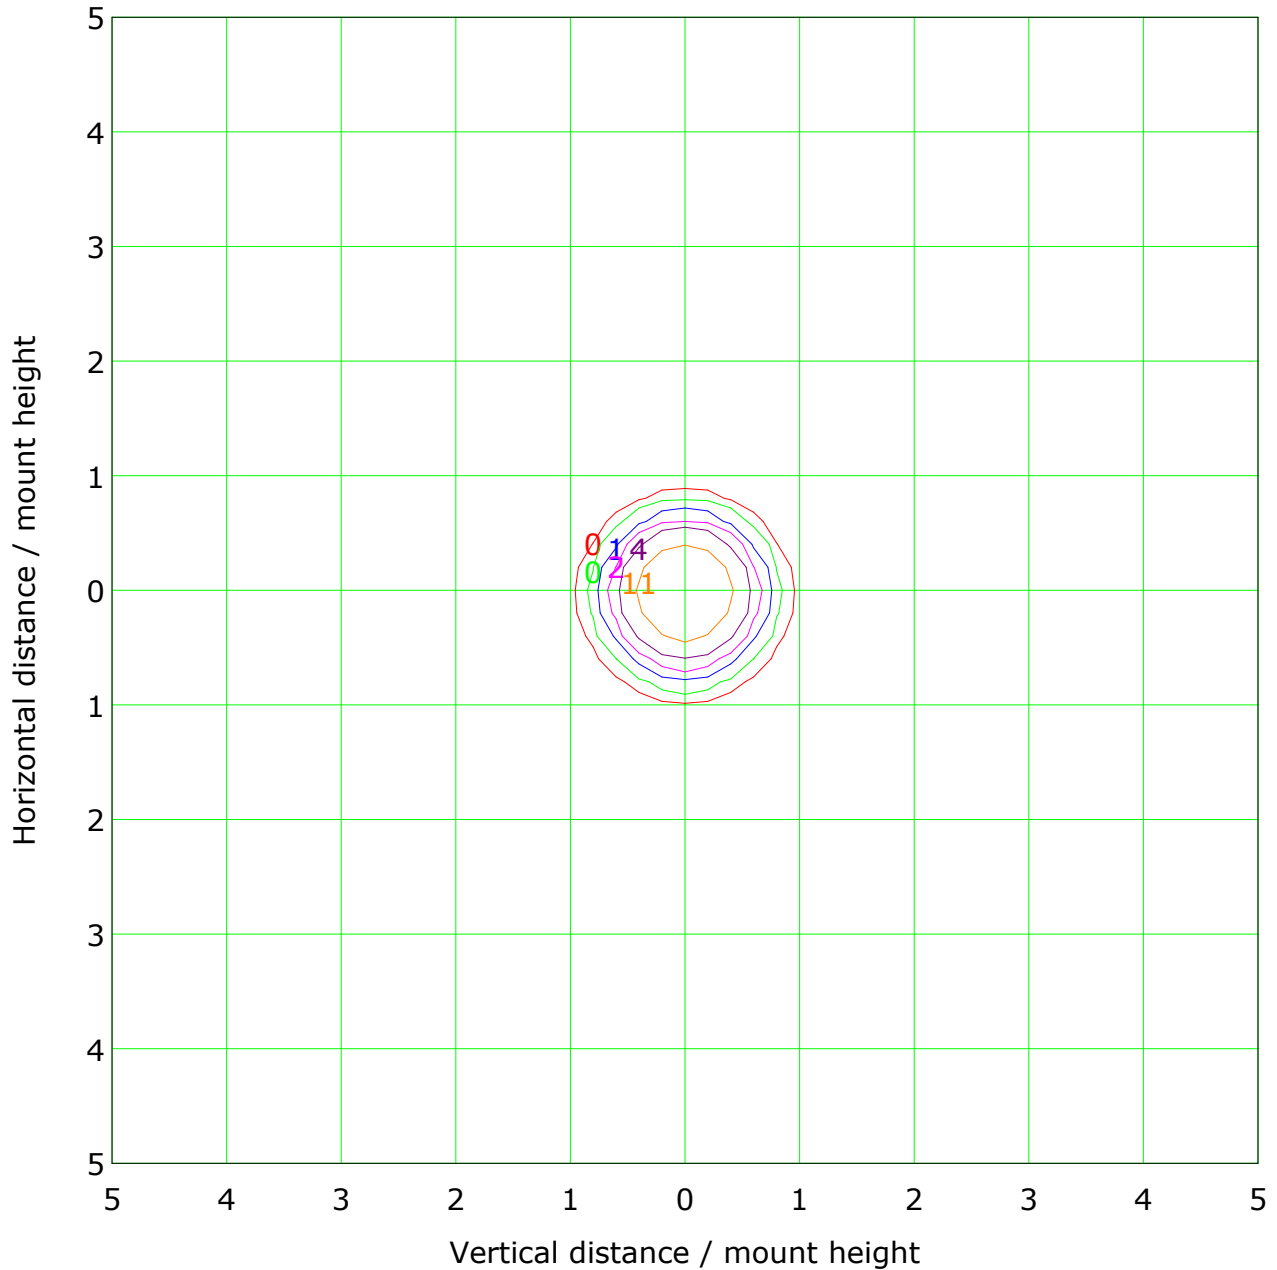


Mounting Height: 10.0m Max Lux(100%): 21.5 lx

| | |
|-----------------|-----------------|
| (1%): 0.2 lx | (2%): 0.4 lx |
| (5%): 1.1 lx | (10%): 2.1 lx |
| (20%): 4.3 lx | (50%): 10.7 lx |
| (100%): 21.5 lx | |


C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Illuminance at a Distance

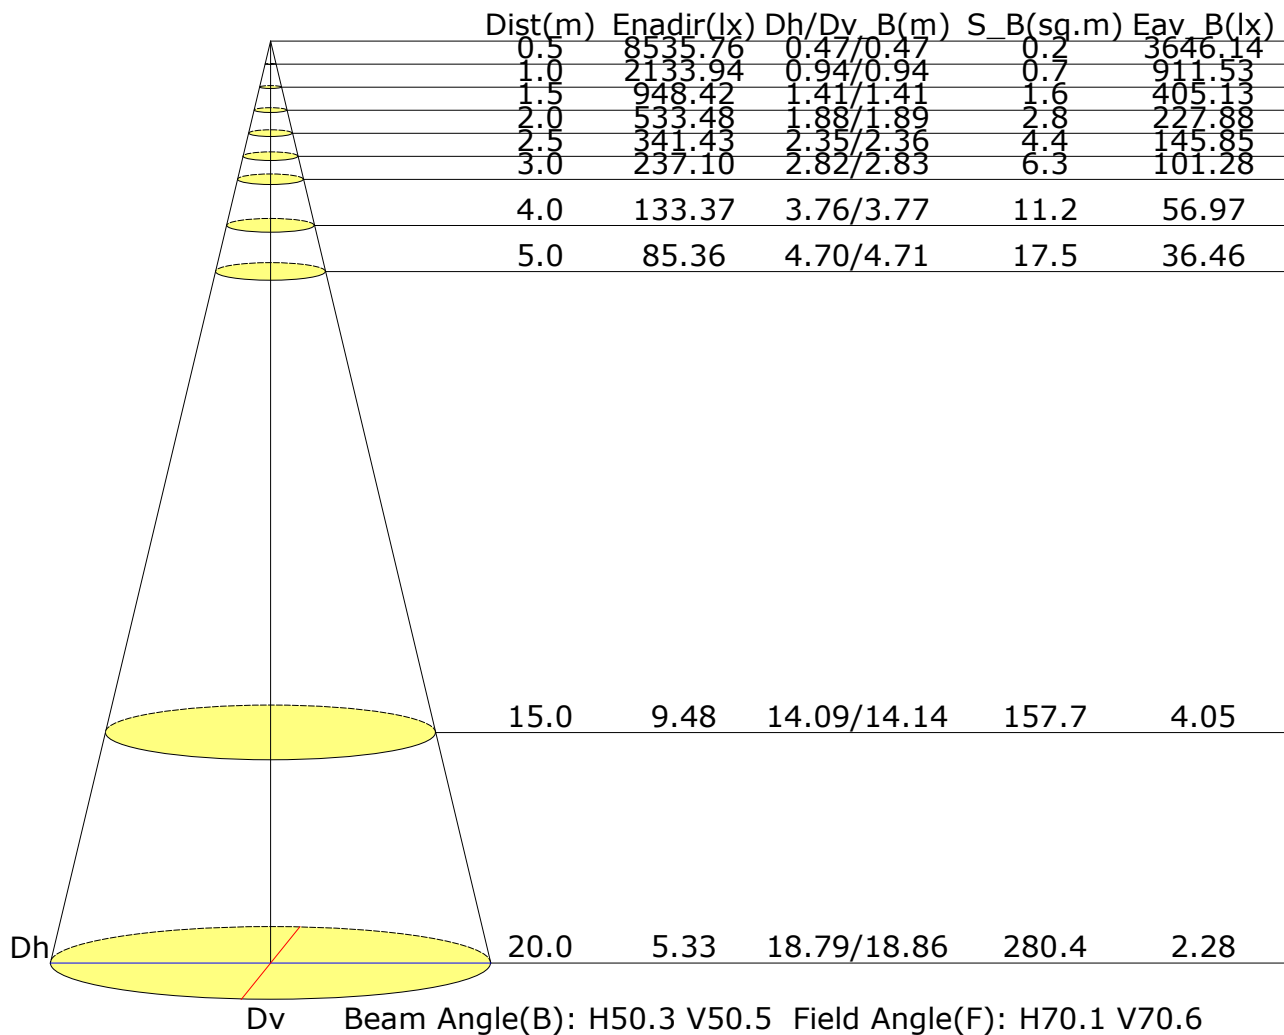

Vertical IsoLux Plot

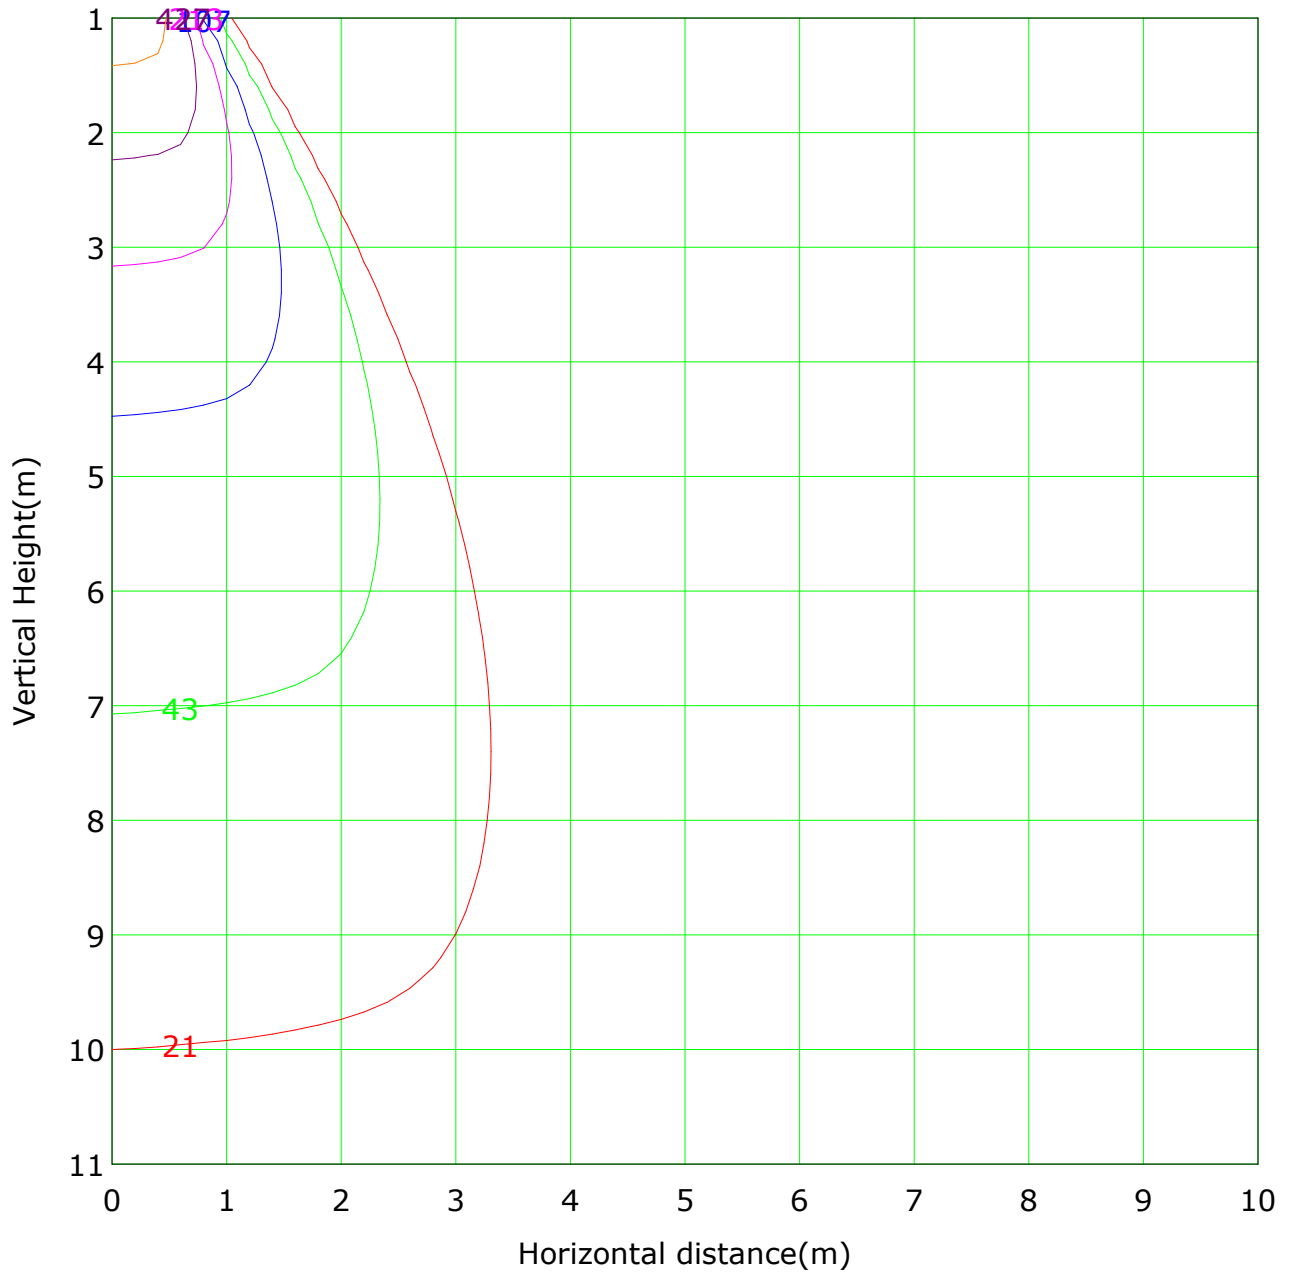

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 2133.9 lx

| | |
|-------------------|-------------------|
| (1%): 21.3 lx | (2%): 42.7 lx |
| (5%): 106.7 lx | (10%): 213.4 lx |
| (20%): 426.8 lx | (50%): 1067.0 lx |
| (100%): 2133.9 lx | |


C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Unit: lm

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

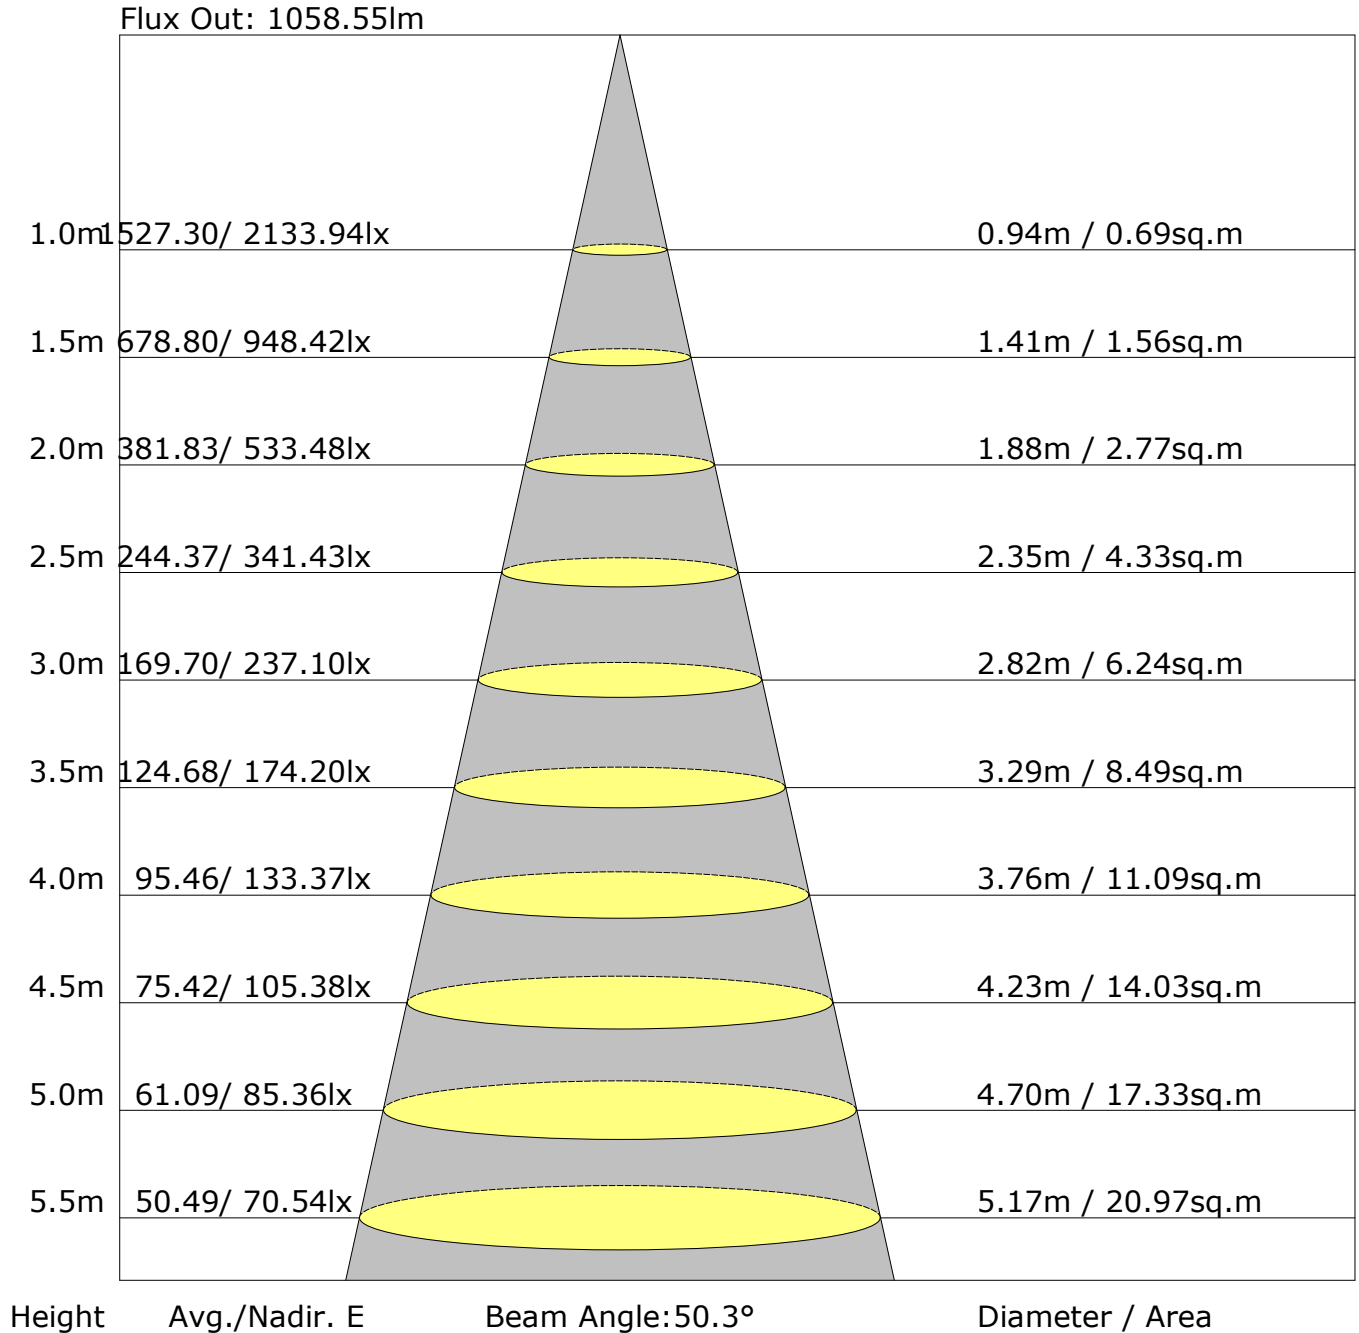

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

UGR Table


| | | | | | | | | | | |
|--|------------------|------|------|------|------|----------------|------|------|------|------|
| Reflectance: | | | | | | | | | | |
| Ceiling (cavity) | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 |
| Wall | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 |
| Reference plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Room dimensions | Viewed crosswise | | | | | Viewed endwise | | | | |
| X=2H Y=2H | 18.2 | 19.0 | 18.4 | 19.2 | 19.4 | 16.9 | 17.7 | 17.2 | 17.9 | 18.1 |
| 3H | 18.1 | 18.8 | 18.4 | 19.1 | 19.3 | 16.9 | 17.6 | 17.2 | 17.8 | 18.0 |
| 4H | 18.1 | 18.7 | 18.4 | 19.0 | 19.2 | 16.8 | 17.5 | 17.1 | 17.7 | 18.0 |
| 6H | 18.0 | 18.6 | 18.4 | 18.9 | 19.2 | 16.8 | 17.4 | 17.1 | 17.7 | 18.0 |
| 8H | 18.0 | 18.6 | 18.3 | 18.9 | 19.2 | 16.8 | 17.4 | 17.1 | 17.6 | 18.0 |
| 12H | 18.0 | 18.5 | 18.3 | 18.8 | 19.2 | 16.7 | 17.3 | 17.1 | 17.6 | 17.9 |
| X=4H Y=2H | 18.0 | 18.7 | 18.3 | 18.9 | 19.2 | 16.8 | 17.4 | 17.1 | 17.7 | 18.0 |
| 3H | 18.0 | 18.5 | 18.3 | 18.8 | 19.1 | 16.7 | 17.3 | 17.1 | 17.6 | 17.9 |
| 4H | 17.9 | 18.4 | 18.3 | 18.8 | 19.1 | 16.7 | 17.2 | 17.1 | 17.5 | 17.9 |
| 6H | 17.9 | 18.3 | 18.3 | 18.7 | 19.1 | 16.7 | 17.1 | 17.1 | 17.5 | 17.9 |
| 8H | 17.9 | 18.3 | 18.3 | 18.6 | 19.1 | 16.7 | 17.1 | 17.1 | 17.5 | 17.9 |
| 12H | 17.8 | 18.2 | 18.3 | 18.6 | 19.0 | 16.7 | 17.0 | 17.1 | 17.4 | 17.9 |
| X=8H Y=4H | 17.8 | 18.2 | 18.2 | 18.6 | 19.0 | 16.6 | 17.0 | 17.0 | 17.4 | 17.8 |
| 6H | 17.8 | 18.1 | 18.2 | 18.5 | 19.0 | 16.6 | 16.9 | 17.1 | 17.4 | 17.8 |
| 8H | 17.8 | 18.1 | 18.2 | 18.5 | 19.0 | 16.6 | 16.9 | 17.1 | 17.3 | 17.8 |
| 12H | 17.8 | 18.0 | 18.2 | 18.5 | 19.0 | 16.6 | 16.9 | 17.1 | 17.3 | 17.8 |
| X=12H Y=4H | 17.8 | 18.1 | 18.2 | 18.5 | 19.0 | 16.6 | 16.9 | 17.0 | 17.3 | 17.8 |
| 6H | 17.7 | 18.0 | 18.2 | 18.5 | 19.0 | 16.6 | 16.9 | 17.0 | 17.3 | 17.8 |
| 8H | 17.7 | 18.0 | 18.2 | 18.5 | 19.0 | 16.6 | 16.8 | 17.1 | 17.3 | 17.8 |
| Variations with the observer position at spacings: | | | | | | | | | | |
| S=1.0H | +5.6/-7.3 | | | | | +5.4/-6.6 | | | | |
| S=1.5H | +8.4/-7.9 | | | | | +8.1/-7.3 | | | | |
| S=2.0H | +10.4/-8.8 | | | | | +10.1/-8.0 | | | | |

Calculate in accordance with CIE Pub.117. The table is revised with 1469lm ($8\log(F/F_0) = 1.3$).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

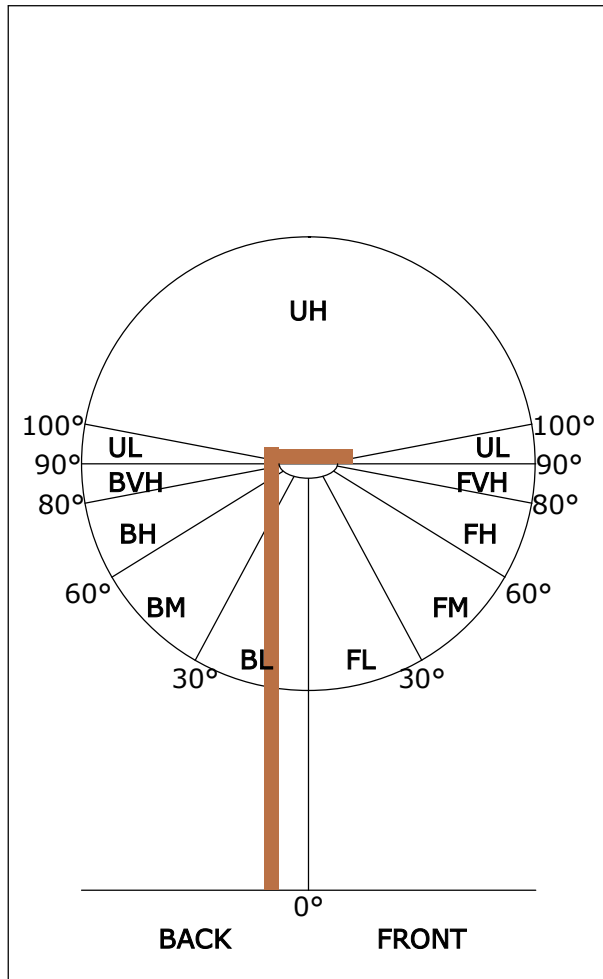

| ZONE | LUMENS | % LAMP LUMENS |
|----------------|--------|---------------|
| FORWARD LIGHT | 776 | 52.8 |
| FL (0°-30°) | 653 | 44.5 |
| FM (30°-60°) | 118 | 8.0 |
| FH (60°-80°) | 5 | 0.3 |
| FVH (80°-90°) | 1 | 0.0 |
| BACK LIGHT | 693 | 47.2 |
| BL (0°-30°) | 605 | 41.2 |
| BM (30°-60°) | 83 | 5.7 |
| BH (60°-80°) | 4 | 0.3 |
| BVH (80°-90°) | 1 | 0.0 |
| UP LIGHT | 0 | 0.0 |
| UL (90°-100°) | 0 | 0.0 |
| UH (100°-180°) | 0 | 0.0 |
| TRAPPED LIGHT | NA | NA |

| BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07 | |
|--|----------|
| Asymmetrical Luminaire Types (Type I,II,III,IV) | B2 U0 G0 |
| Quadrilateral Symmetrical Luminaire Types (Type V,Area Light) | B2 U0 G0 |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Zonal Lumen

| Gamma [°] | I _{mean} [cd] | Zonal Flux [lm] | Sum Zonal Flux [lm] | Rel Zonal Flux [%] | Sum Rel Zonal Flux [%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 0.0-1.0 | 2134.7 | 2.0 | 2.0 | 0.14 | 0.14 |
| 1.0-2.0 | 2136.5 | 6.1 | 8.2 | 0.42 | 0.56 |
| 2.0-3.0 | 2138.3 | 10.2 | 18.4 | 0.70 | 1.25 |
| 3.0-4.0 | 2140.8 | 14.3 | 32.7 | 0.98 | 2.23 |
| 4.0-5.0 | 2143.7 | 18.4 | 51.2 | 1.26 | 3.48 |
| 5.0-6.0 | 2146.3 | 22.6 | 73.7 | 1.54 | 5.02 |
| 6.0-7.0 | 2148.5 | 26.7 | 100.4 | 1.82 | 6.84 |
| 7.0-8.0 | 2149.2 | 30.8 | 131.2 | 2.09 | 8.93 |
| 8.0-9.0 | 2148.3 | 34.8 | 166.0 | 2.37 | 11.30 |
| 9.0-10.0 | 2145.3 | 38.8 | 204.8 | 2.64 | 13.94 |
| 10.0-11.0 | 2138.7 | 42.7 | 247.6 | 2.91 | 16.85 |
| 11.0-12.0 | 2127.6 | 46.5 | 294.1 | 3.17 | 20.02 |
| 12.0-13.0 | 2110.4 | 50.1 | 344.2 | 3.41 | 23.43 |
| 13.0-14.0 | 2085.8 | 53.4 | 397.6 | 3.64 | 27.06 |
| 14.0-15.0 | 2052.3 | 56.3 | 453.9 | 3.84 | 30.90 |
| 15.0-16.0 | 2008.6 | 58.9 | 512.8 | 4.01 | 34.91 |
| 16.0-17.0 | 1953.3 | 60.8 | 573.6 | 4.14 | 39.05 |
| 17.0-18.0 | 1885.2 | 62.2 | 635.8 | 4.23 | 43.28 |
| 18.0-19.0 | 1804.2 | 62.8 | 698.6 | 4.27 | 47.55 |
| 19.0-20.0 | 1712.3 | 62.7 | 761.2 | 4.27 | 51.82 |
| 20.0-21.0 | 1611.5 | 61.9 | 823.1 | 4.21 | 56.03 |
| 21.0-22.0 | 1503.4 | 60.4 | 883.5 | 4.11 | 60.15 |
| 22.0-23.0 | 1390.8 | 58.4 | 941.9 | 3.97 | 64.12 |
| 23.0-24.0 | 1275.8 | 55.8 | 997.7 | 3.80 | 67.92 |
| 24.0-25.0 | 1160.1 | 52.8 | 1050.5 | 3.59 | 71.51 |
| 25.0-26.0 | 1044.9 | 49.3 | 1099.8 | 3.36 | 74.87 |
| 26.0-27.0 | 932.1 | 45.6 | 1145.4 | 3.10 | 77.97 |
| 27.0-28.0 | 823.4 | 41.7 | 1187.1 | 2.84 | 80.81 |
| 28.0-29.0 | 719.6 | 37.7 | 1224.7 | 2.56 | 83.37 |
| 29.0-30.0 | 621.3 | 33.6 | 1258.3 | 2.28 | 85.66 |
| 30.0-31.0 | 530.7 | 29.5 | 1287.8 | 2.01 | 87.67 |
| 31.0-32.0 | 448.1 | 25.7 | 1313.5 | 1.75 | 89.42 |
| 32.0-33.0 | 374.2 | 22.0 | 1335.6 | 1.50 | 90.92 |
| 33.0-34.0 | 310.6 | 18.8 | 1354.4 | 1.28 | 92.20 |
| 34.0-35.0 | 255.2 | 15.9 | 1370.2 | 1.08 | 93.28 |
| 35.0-36.0 | 207.0 | 13.2 | 1383.4 | 0.90 | 94.17 |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

| Gamma [°] | I _{mean} [cd] | Zonal Flux [lm] | Sum Zonal Flux [lm] | Rel Zonal Flux [%] | Sum Rel Zonal Flux [%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 36.0-37.0 | 168.4 | 11.0 | 1394.4 | 0.75 | 94.92 |
| 37.0-38.0 | 139.0 | 9.3 | 1403.7 | 0.63 | 95.55 |
| 38.0-39.0 | 115.2 | 7.9 | 1411.5 | 0.54 | 96.09 |
| 39.0-40.0 | 95.3 | 6.7 | 1418.2 | 0.45 | 96.54 |
| 40.0-41.0 | 78.3 | 5.6 | 1423.7 | 0.38 | 96.92 |
| 41.0-42.0 | 63.9 | 4.6 | 1428.4 | 0.32 | 97.24 |
| 42.0-43.0 | 53.2 | 3.9 | 1432.3 | 0.27 | 97.51 |
| 43.0-44.0 | 45.2 | 3.4 | 1435.7 | 0.23 | 97.74 |
| 44.0-45.0 | 38.6 | 3.0 | 1438.7 | 0.20 | 97.94 |
| 45.0-46.0 | 32.9 | 2.6 | 1441.3 | 0.18 | 98.12 |
| 46.0-47.0 | 28.2 | 2.2 | 1443.5 | 0.15 | 98.27 |
| 47.0-48.0 | 24.2 | 2.0 | 1445.5 | 0.13 | 98.40 |
| 48.0-49.0 | 20.8 | 1.7 | 1447.2 | 0.12 | 98.52 |
| 49.0-50.0 | 18.0 | 1.5 | 1448.7 | 0.10 | 98.62 |
| 50.0-51.0 | 16.0 | 1.4 | 1450.0 | 0.09 | 98.71 |
| 51.0-52.0 | 14.5 | 1.2 | 1451.3 | 0.08 | 98.80 |
| 52.0-53.0 | 13.3 | 1.2 | 1452.4 | 0.08 | 98.88 |
| 53.0-54.0 | 12.3 | 1.1 | 1453.5 | 0.07 | 98.95 |
| 54.0-55.0 | 11.4 | 1.0 | 1454.5 | 0.07 | 99.02 |
| 55.0-56.0 | 10.8 | 1.0 | 1455.5 | 0.07 | 99.09 |
| 56.0-57.0 | 10.2 | 0.9 | 1456.5 | 0.06 | 99.15 |
| 57.0-58.0 | 9.6 | 0.9 | 1457.3 | 0.06 | 99.21 |
| 58.0-59.0 | 9.2 | 0.9 | 1458.2 | 0.06 | 99.27 |
| 59.0-60.0 | 8.6 | 0.8 | 1459.0 | 0.06 | 99.32 |
| 60.0-61.0 | 8.0 | 0.8 | 1459.8 | 0.05 | 99.38 |
| 61.0-62.0 | 7.4 | 0.7 | 1460.5 | 0.05 | 99.42 |
| 62.0-63.0 | 6.9 | 0.7 | 1461.2 | 0.05 | 99.47 |
| 63.0-64.0 | 6.6 | 0.6 | 1461.8 | 0.04 | 99.51 |
| 64.0-65.0 | 6.3 | 0.6 | 1462.4 | 0.04 | 99.56 |
| 65.0-66.0 | 5.8 | 0.6 | 1463.0 | 0.04 | 99.60 |
| 66.0-67.0 | 5.3 | 0.5 | 1463.5 | 0.04 | 99.63 |
| 67.0-68.0 | 4.9 | 0.5 | 1464.0 | 0.03 | 99.66 |
| 68.0-69.0 | 4.5 | 0.5 | 1464.5 | 0.03 | 99.70 |
| 69.0-70.0 | 4.2 | 0.4 | 1464.9 | 0.03 | 99.73 |
| 70.0-71.0 | 3.9 | 0.4 | 1465.3 | 0.03 | 99.75 |
| 71.0-72.0 | 3.5 | 0.4 | 1465.7 | 0.03 | 99.78 |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

| G\C | C0.0 | C180.0 | | | | | | | | |
|-------|--------|--------|--|--|--|--|--|--|--|--|
| G0.0 | 2133.9 | 2133.9 | | | | | | | | |
| G1.0 | 2132.3 | 2138.8 | | | | | | | | |
| G2.0 | 2129.0 | 2146.0 | | | | | | | | |
| G3.0 | 2124.4 | 2153.8 | | | | | | | | |
| G4.0 | 2122.8 | 2162.2 | | | | | | | | |
| G5.0 | 2120.9 | 2168.8 | | | | | | | | |
| G6.0 | 2121.6 | 2173.9 | | | | | | | | |
| G7.0 | 2120.5 | 2177.9 | | | | | | | | |
| G8.0 | 2119.3 | 2179.3 | | | | | | | | |
| G9.0 | 2117.4 | 2177.4 | | | | | | | | |
| G10.0 | 2114.8 | 2171.4 | | | | | | | | |
| G11.0 | 2111.4 | 2157.3 | | | | | | | | |
| G12.0 | 2106.5 | 2135.2 | | | | | | | | |
| G13.0 | 2098.6 | 2101.5 | | | | | | | | |
| G14.0 | 2086.5 | 2056.7 | | | | | | | | |
| G15.0 | 2066.3 | 1999.7 | | | | | | | | |
| G16.0 | 2038.7 | 1929.6 | | | | | | | | |
| G17.0 | 1999.4 | 1845.6 | | | | | | | | |
| G18.0 | 1947.2 | 1748.7 | | | | | | | | |
| G19.0 | 1881.9 | 1639.0 | | | | | | | | |
| G20.0 | 1805.3 | 1522.8 | | | | | | | | |
| G21.0 | 1718.2 | 1399.6 | | | | | | | | |
| G22.0 | 1622.5 | 1273.3 | | | | | | | | |
| G23.0 | 1519.4 | 1147.7 | | | | | | | | |
| G24.0 | 1411.8 | 1024.2 | | | | | | | | |
| G25.0 | 1301.1 | 903.3 | | | | | | | | |
| G26.0 | 1186.9 | 788.2 | | | | | | | | |
| G27.0 | 1072.2 | 681.1 | | | | | | | | |
| G28.0 | 958.9 | 581.5 | | | | | | | | |
| G29.0 | 847.1 | 491.0 | | | | | | | | |
| G30.0 | 738.1 | 409.0 | | | | | | | | |
| G31.0 | 638.1 | 337.3 | | | | | | | | |
| G32.0 | 540.4 | 276.8 | | | | | | | | |
| G33.0 | 454.2 | 225.4 | | | | | | | | |
| G34.0 | 380.8 | 181.9 | | | | | | | | |
| G35.0 | 315.1 | 143.1 | | | | | | | | |
| G36.0 | 259.8 | 109.9 | | | | | | | | |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

Candlepower Table (Continue 1)

Unit: cd

| G\C | C0.0 | C180.0 | | | | | | | | |
|-------|-------|--------|--|--|--|--|--|--|--|--|
| G37.0 | 214.0 | 90.1 | | | | | | | | |
| G38.0 | 175.9 | 76.1 | | | | | | | | |
| G39.0 | 144.5 | 64.3 | | | | | | | | |
| G40.0 | 118.7 | 53.8 | | | | | | | | |
| G41.0 | 96.2 | 44.5 | | | | | | | | |
| G42.0 | 78.7 | 36.4 | | | | | | | | |
| G43.0 | 67.8 | 29.8 | | | | | | | | |
| G44.0 | 58.7 | 24.6 | | | | | | | | |
| G45.0 | 50.3 | 20.6 | | | | | | | | |
| G46.0 | 42.8 | 17.9 | | | | | | | | |
| G47.0 | 35.9 | 16.1 | | | | | | | | |
| G48.0 | 30.2 | 14.4 | | | | | | | | |
| G49.0 | 25.5 | 13.0 | | | | | | | | |
| G50.0 | 21.5 | 12.2 | | | | | | | | |
| G51.0 | 18.9 | 11.5 | | | | | | | | |
| G52.0 | 16.9 | 10.8 | | | | | | | | |
| G53.0 | 15.4 | 10.1 | | | | | | | | |
| G54.0 | 14.0 | 9.6 | | | | | | | | |
| G55.0 | 13.1 | 8.9 | | | | | | | | |
| G56.0 | 12.3 | 8.8 | | | | | | | | |
| G57.0 | 11.6 | 8.0 | | | | | | | | |
| G58.0 | 11.2 | 7.6 | | | | | | | | |
| G59.0 | 10.6 | 7.3 | | | | | | | | |
| G60.0 | 9.9 | 6.7 | | | | | | | | |
| G61.0 | 9.1 | 6.4 | | | | | | | | |
| G62.0 | 8.4 | 5.9 | | | | | | | | |
| G63.0 | 7.8 | 5.6 | | | | | | | | |
| G64.0 | 7.4 | 5.6 | | | | | | | | |
| G65.0 | 6.7 | 5.3 | | | | | | | | |
| G66.0 | 6.2 | 4.9 | | | | | | | | |
| G67.0 | 5.6 | 4.5 | | | | | | | | |
| G68.0 | 5.0 | 4.3 | | | | | | | | |
| G69.0 | 4.6 | 4.2 | | | | | | | | |
| G70.0 | 4.2 | 3.9 | | | | | | | | |
| G71.0 | 3.9 | 3.4 | | | | | | | | |
| G72.0 | 3.6 | 3.2 | | | | | | | | |
| G73.0 | 3.4 | 2.9 | | | | | | | | |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:


Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:



Unit: cd

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 2.905 m
Humidity:
Inspector: